

Moonlite™ LED



Emergency & Security

1 Fc Average: 0.1 Fc Minimum

SPACING GUIDE

Tested in Accordance with IES Standard LM-79-08 for Solid State Lighting Products

Down Light- Series MLD, MLS, & MRD

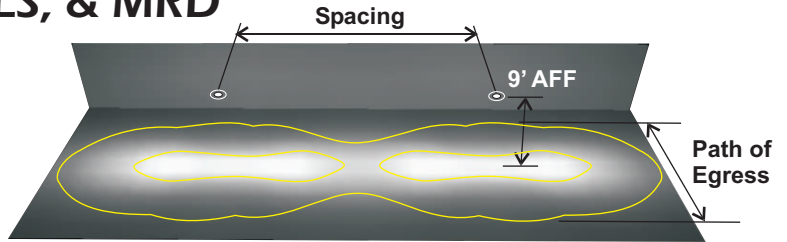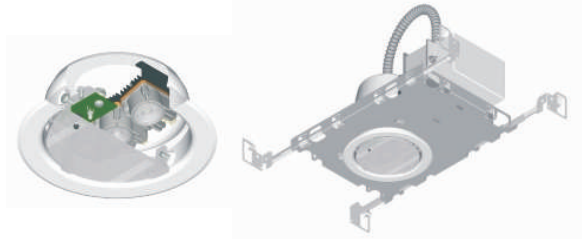

Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
10 L2	9'	50'	40'	25'
15 L3	9'	55'	50'	40'


Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10 L2	1.03	0.39	7.21	2.64
15 L3	1.21	0.16	26.13	7.56

Interior Wall Mount- Series MLW

10L2



15L3

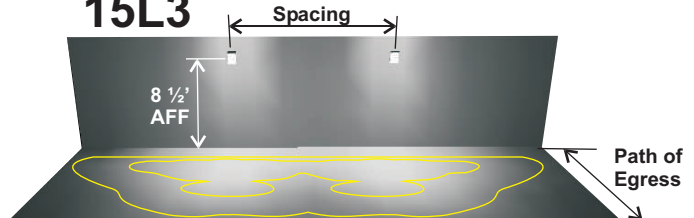


Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
10 L2	8 1/2'	40'	35'	25'
15 L3	8 1/2'	45'	40'	35'


Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10 L2	1.02	0.16	19.31	6.38
15 L3	1.19	0.15	28.60	7.93

Exterior Wall Mount- Series MOE

10L2

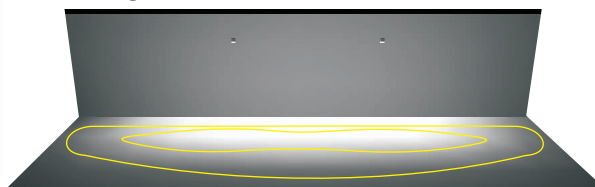

15L3

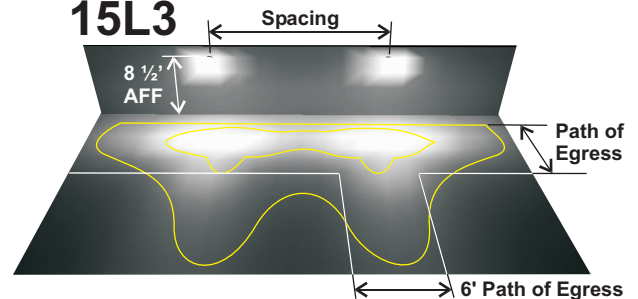

Model	Mtg. Ht.	SPACING		
		Path of Egress Width		
		3 Ft.	6 Ft.	10 Ft.
10 L2	8 1/2'	40'	30'	20'
15 L3*	8 1/2'	40'	35'	30'

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
10 L2	1.09	0.36	8.17	3.03
15 L3	1.16	0.16	23.69	7.25

*15 L3 Projection from Building: 30 Ft

CONTACT SIGNTEX FOR LAYOUT ASSISTANCE

Code Compliant Emergency lighting layouts provided free of charge!

NOTE: FOR REFERENCE ONLY. STANDARD REFLECTANCES 80/50/20. SIGNTEX IS NOT RESPONSIBLE FOR SPECIFIC CONDITIONS THAT MAY ALTER THE RESULTS. COMPLETE IES PHOTOMETRIC DATA AVAILABLE AT WWW.SIGNTEXINC.COM FOR YOUR CONVENIENCE.



Signtex Inc
LIGHTING

220 VFVAvenue, Grasonville, MD 21638
TEL: (410) 827-8300 Fax: (410) 827-8866
sales@signtexinc.com www.signtexinc.com


Moonlite™ LED

Emergency & Security

2 Fc Average: 1 Fc Minimum SPACING GUIDE

Tested in Accordance with IES Standard LM-79-08 for Solid State Lighting Products

Down Light- Series MLD, MLS, & MRD

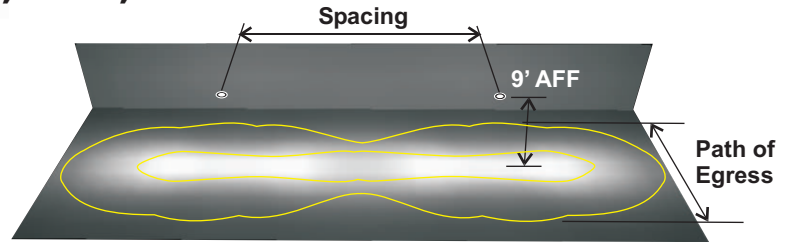


15L3

Illuminance Values- 3 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
15 L3	3.18	1.73	2.49	1.84

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
15 L3	9'	30'	30'

Interior Wall Mount- Series MLW

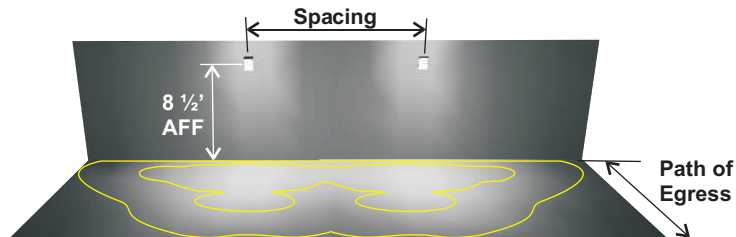


15L3

Illuminance Values- 3 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
15 L3	1.83	1.27	1.76	1.44

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
15 L3	8 1/2'	25'	20'

Exterior Wall Mount- Series MOE

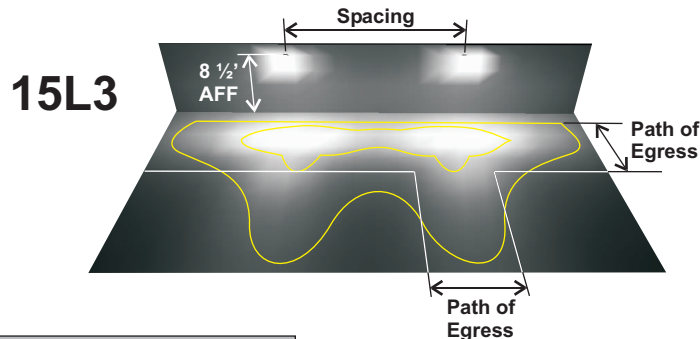

15L3

Illuminance Values- 6 Ft. Path of Egress				
	Average	Minimum	Max./Min. Ratio	Avg./Min. Ratio
15 L3	2.58	1.62	2.27	1.59

Model	Mtg. Ht.	Path of Egress Width	
		3 Ft.	6 Ft.
15 L3	8 1/2'	20'	15'

CONTACT SIGNTEX FOR LAYOUT ASSISTANCE

Code Compliant Emergency lighting layouts provided free of charge!

NOTE: FOR REFERENCE ONLY. STANDARD REFLECTANCES 80/50/20. SIGNTEX IS NOT RESPONSIBLE FOR SPECIFIC CONDITIONS THAT MAY ALTER THE RESULTS. COMPLETE IES PHOTOMETRIC DATA AVAILABLE AT WWW.SIGNTEXINC.COM FOR YOUR CONVENIENCE.



Signtex Inc
LIGHTING

220 VFW Avenue, Grasonville, MD 21638
TEL: (410) 827-8300 Fax: (410) 827-8866
sales@signtexinc.com www.signtexinc.com